



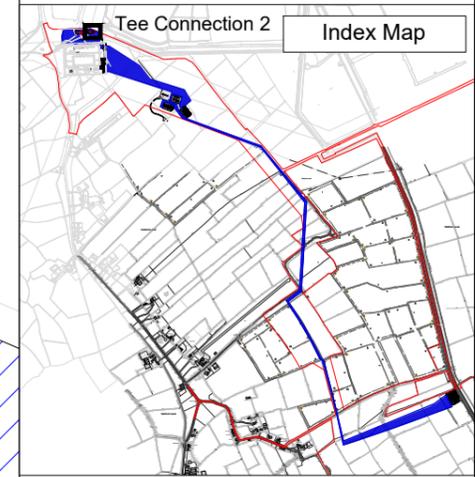

Key

- PEIR Assessment Boundary
- Grid connection corridor

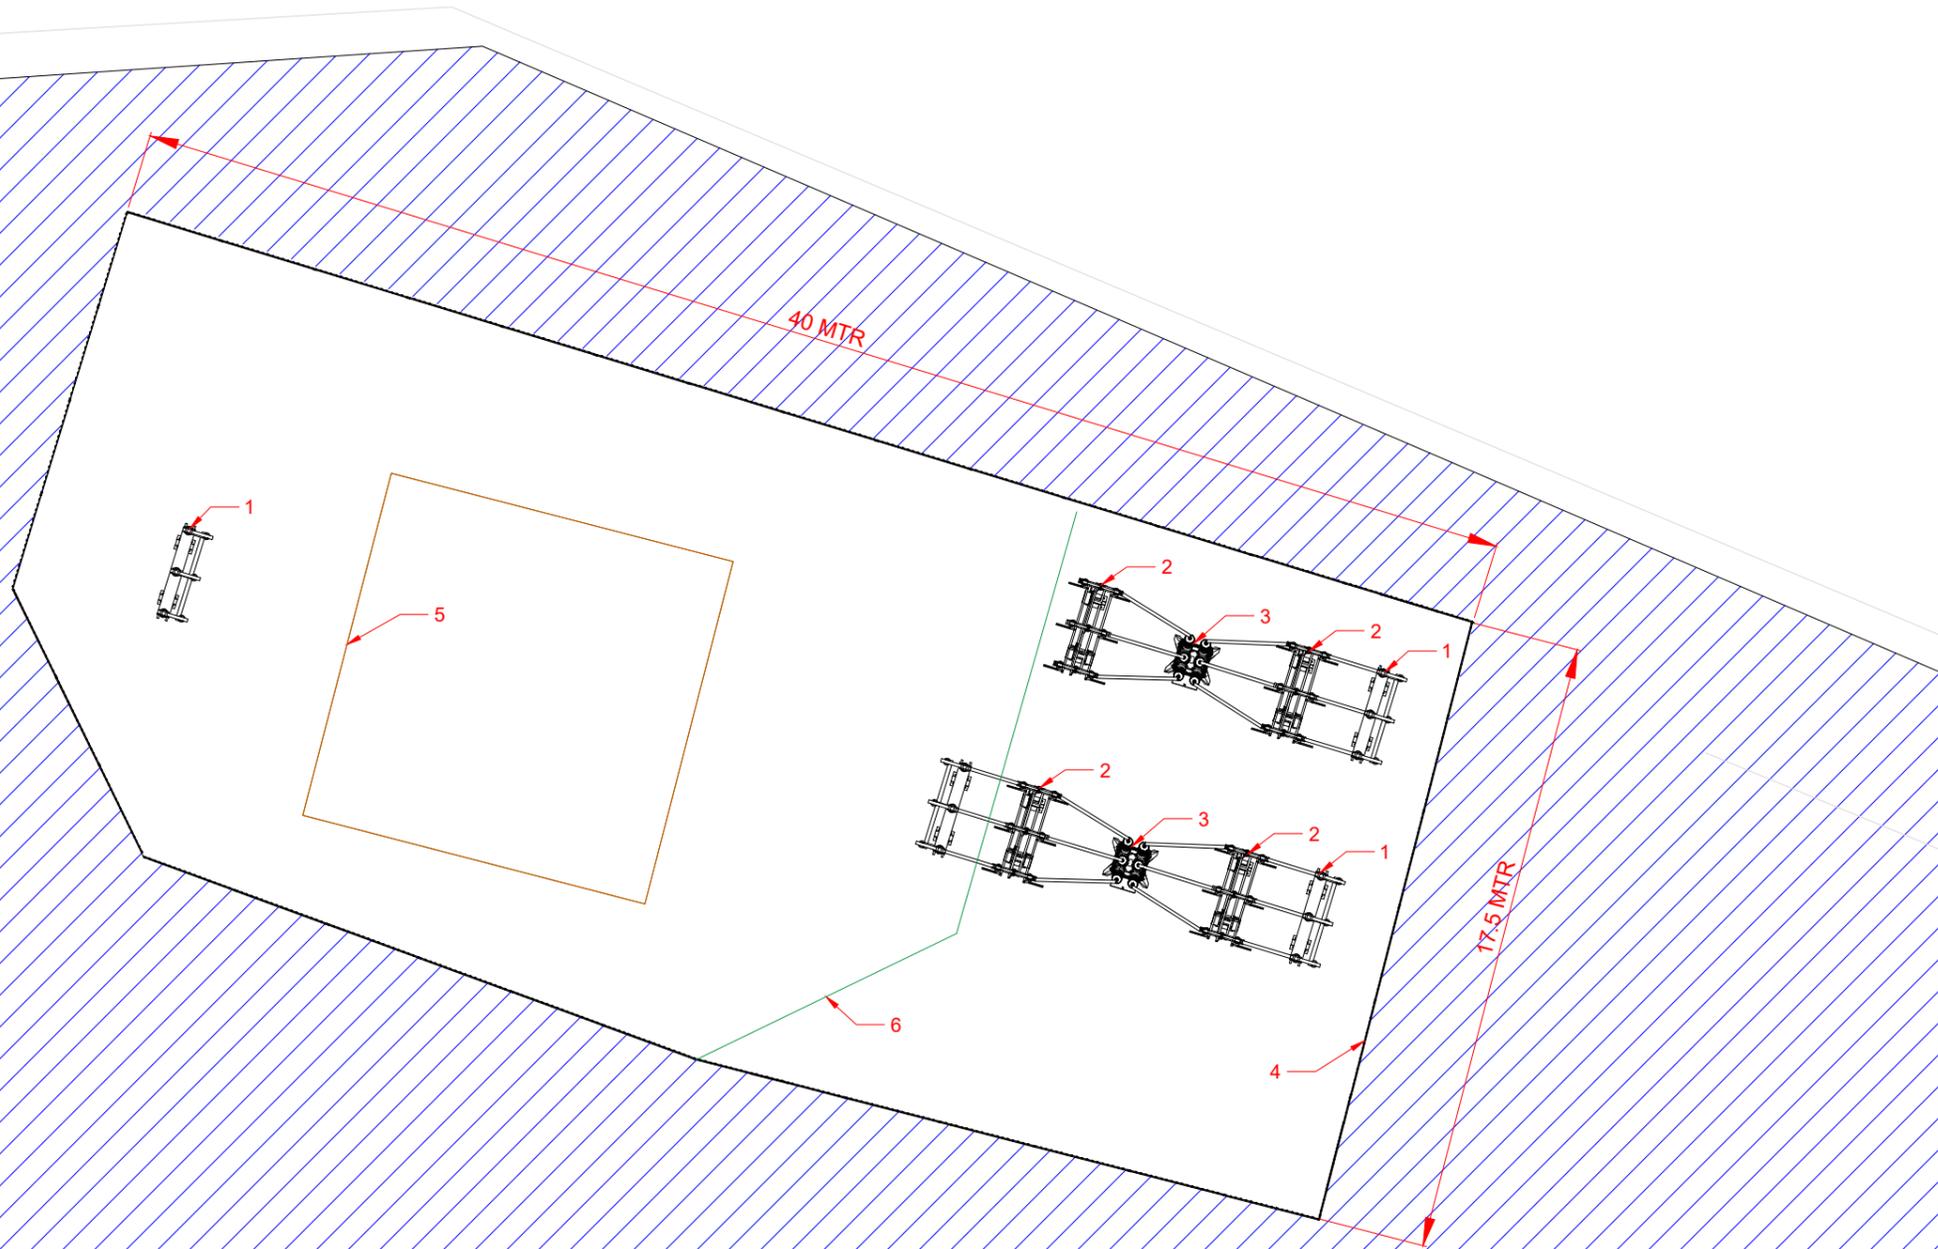

Reproduced from FEL-MC-9059-3100-P2

| | | | | |
|-------------|-------|---------|----------|------------|
| P01 | JP | GG | SB | 28/11/2025 |
| FINAL | | | | |
| REVISION | DRAWN | CHECKED | APPROVED | DATE |
| DESCRIPTION | | | | |



CLIENT NAME:
FUTURE ENERGY LLANWERN LTD

PROJECT TITLE:
FUTURE ENERGY LLANWERN SOLAR FARM PEIR

DRAWING TITLE:
FIGURE 2-14a TEE CONNECTION 2 - 33kV LAYOUT

STATUS:
FINAL

| | | | |
|--------------|----------------|------------------|-------------------|
| DRAWN: JP | CHECKED: GG | APPROVED: JEH | AUTHORISED: SB |
|--------------|----------------|------------------|-------------------|

| | | |
|----------------------------|---------------------|------------------|
| SCALE @ A3 SIZE: 1: 100 | DATE: 28/11/2025 | REVISION: P01 |
|----------------------------|---------------------|------------------|

DRAWING NUMBER:
70109716-WSPE-Y-FG-00035_P01

| EQUIPMENT LIST | |
|----------------|--------------------------------------|
| ITEM No | DESCRIPTION |
| 1 | CABLE SEALING END |
| 2 | DISCONNECTOR |
| 3 | HORIZON 36kV OUTDOOR CIRCUIT BREAKER |
| 4 | 2.4MTR HIGH PERIMETER PALISADE FENCE |
| 5 | OVERHEAD CABLE PYLON TOWER LOCATION |
| 6 | EXISTING FENCE TO BE REMOVED |

C:\Users\UKJXP782\WSP 0365170109716 - Caldicot Levels Solar Farm DCO - Documents (1)\03 - WIP\Drawings\ACAD\70109716-WSPE-Y-FG-00035_P01.dwg Originator: UKJXP782