


ADDITIONAL PILE FOR
INVERTER MOUNTING

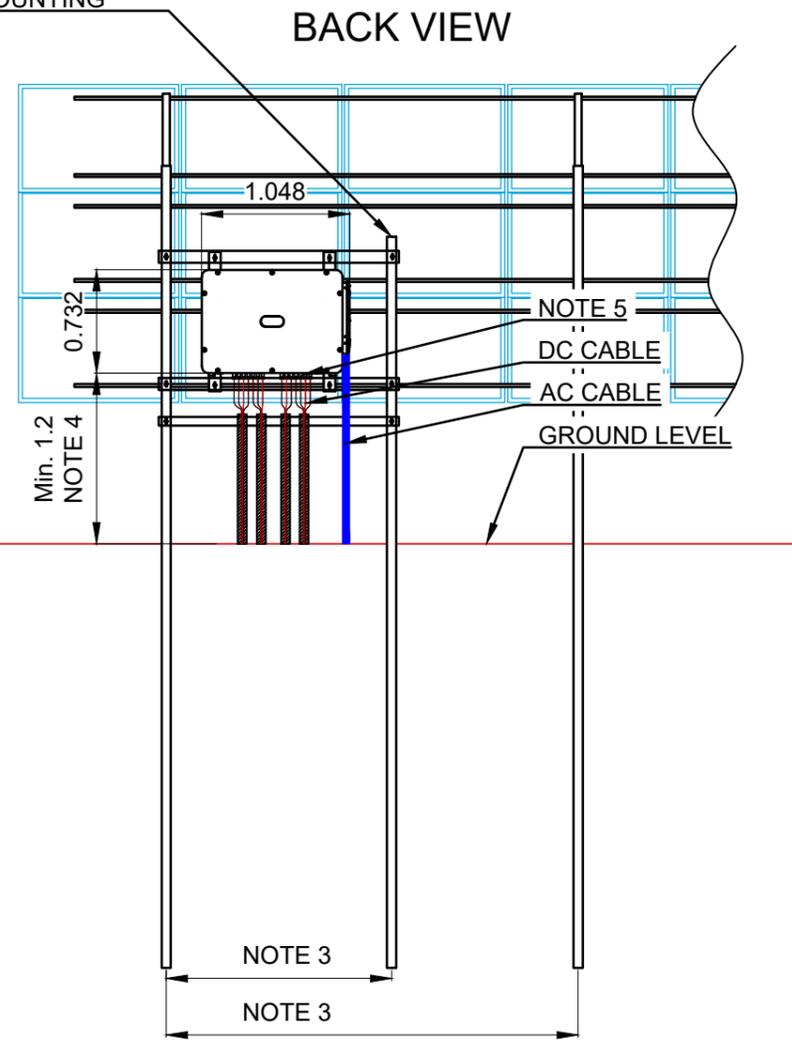

Notes

1. All dimensions to be confirmed on site prior to installation.
2. All dimensions are in metres and are indicative only.
3. Distance to be provided by the equipment manufacturer.
4. Minimum distance of 1.2m to be kept from ground level due to flooding risk.
5. Inverter mounted DC connectors are not visible from the front, this detail is visual representation.

This drawing is copyright of Lighthouse Development Consulting.
Reproduced from Detra Solar FEL1001-202 (23/10/25)

P01	JP	GG	SB	21/11/2025
-----	----	----	----	------------

FINAL				
REVISION	DRAWN	CHECKED	APPROVED	DATE
DESCRIPTION				



CLIENT NAME:
FUTURE ENERGY LLANWERN LTD

PROJECT TITLE:
**FUTURE ENERGY LLANWERN
SOLAR FARM PEIR**

DRAWING TITLE:
**FIGURE 2-4
PV INVERTER MOUNTING DETAILS**

STATUS:
FINAL

DRAWN: JP	CHECKED: GG	APPROVED: JEH	AUTHORISED: SB
--------------	----------------	------------------	-------------------

SCALE @ A3 SIZE: 1:50	DATE: 21/11/2025	REVISION: P01
--------------------------	---------------------	------------------

DRAWING NUMBER:
70109716-WSPE-Y-FG-0004-P01